

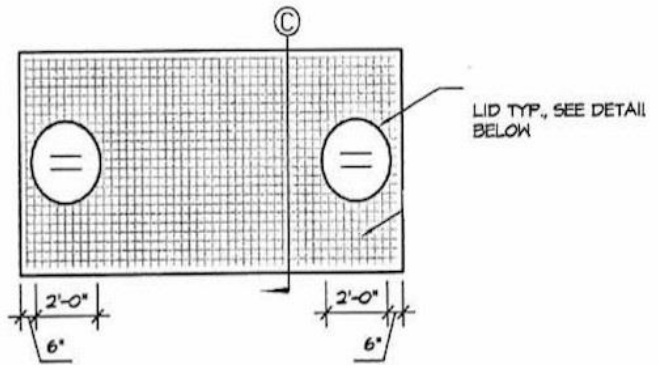


SECTION 'A'

TOP VIEW

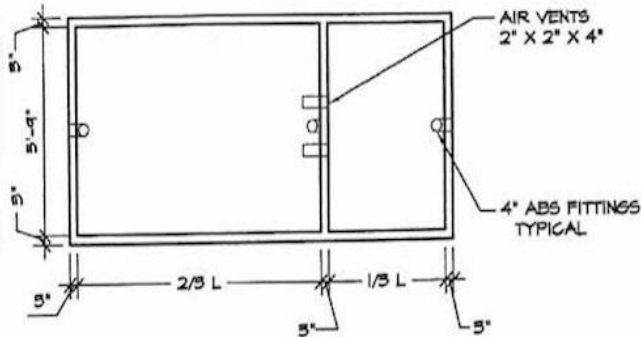

LID SIDE VIEW

Capacity	Height	Width	Length	Outlet
500	4'-3"	3'-7"	8'-7"	
810	5'-8"	4'-1"	8'-8"	53"
1200	5'-10"	5'-2"	9'-3"	55"
1500	5'-8"	6'-3"	9'-6"	53"
2000	5'-8"	6'-3"	12'-6"	53"

NOTES:

1. Tank cover limits the depth of soil on the cover to be Minimum 1'6" and Maximum 4'6"
2. All concrete shall develop a minimum compressive strength of 4000 psi at 28 days or sooner. Concrete shall have a maximum water ratio of 0.45.
3. Cement to be Portland conforming to ASTM C 150. Reinforcing steel shall be intermediate grade, deformed, conforming to ASTM A-616 Grade 40.
4. Reinforcing bars shall be in as long lengths as practicable and shall be lapped a minimum of 15 inches, or 40 bars diameters.
5. All tanks shall be coated on the interior extending to (4) inches below the water line, and shall cover all internal area above that point with an approved damp proof and waterproof compound complying with ASTM D 41-78 or better. Coatings shall be applied per the manufacturer's recommendations and shall be environmentally friendly as per EPA regulation 40CFR261.4
6. Fill tank with water after it has been set in place and backfilled as per manufacturer's recommendation.

H2O TRAFFIC RATED TANKS



Robert E. Kent 5/19/03

SELVAGE CONCRETE PRODUCTS, INC.
 3309 SEBASTOPOL ROAD
 SANTA ROSA, CA 95407
 PHONE 707-542-2762